
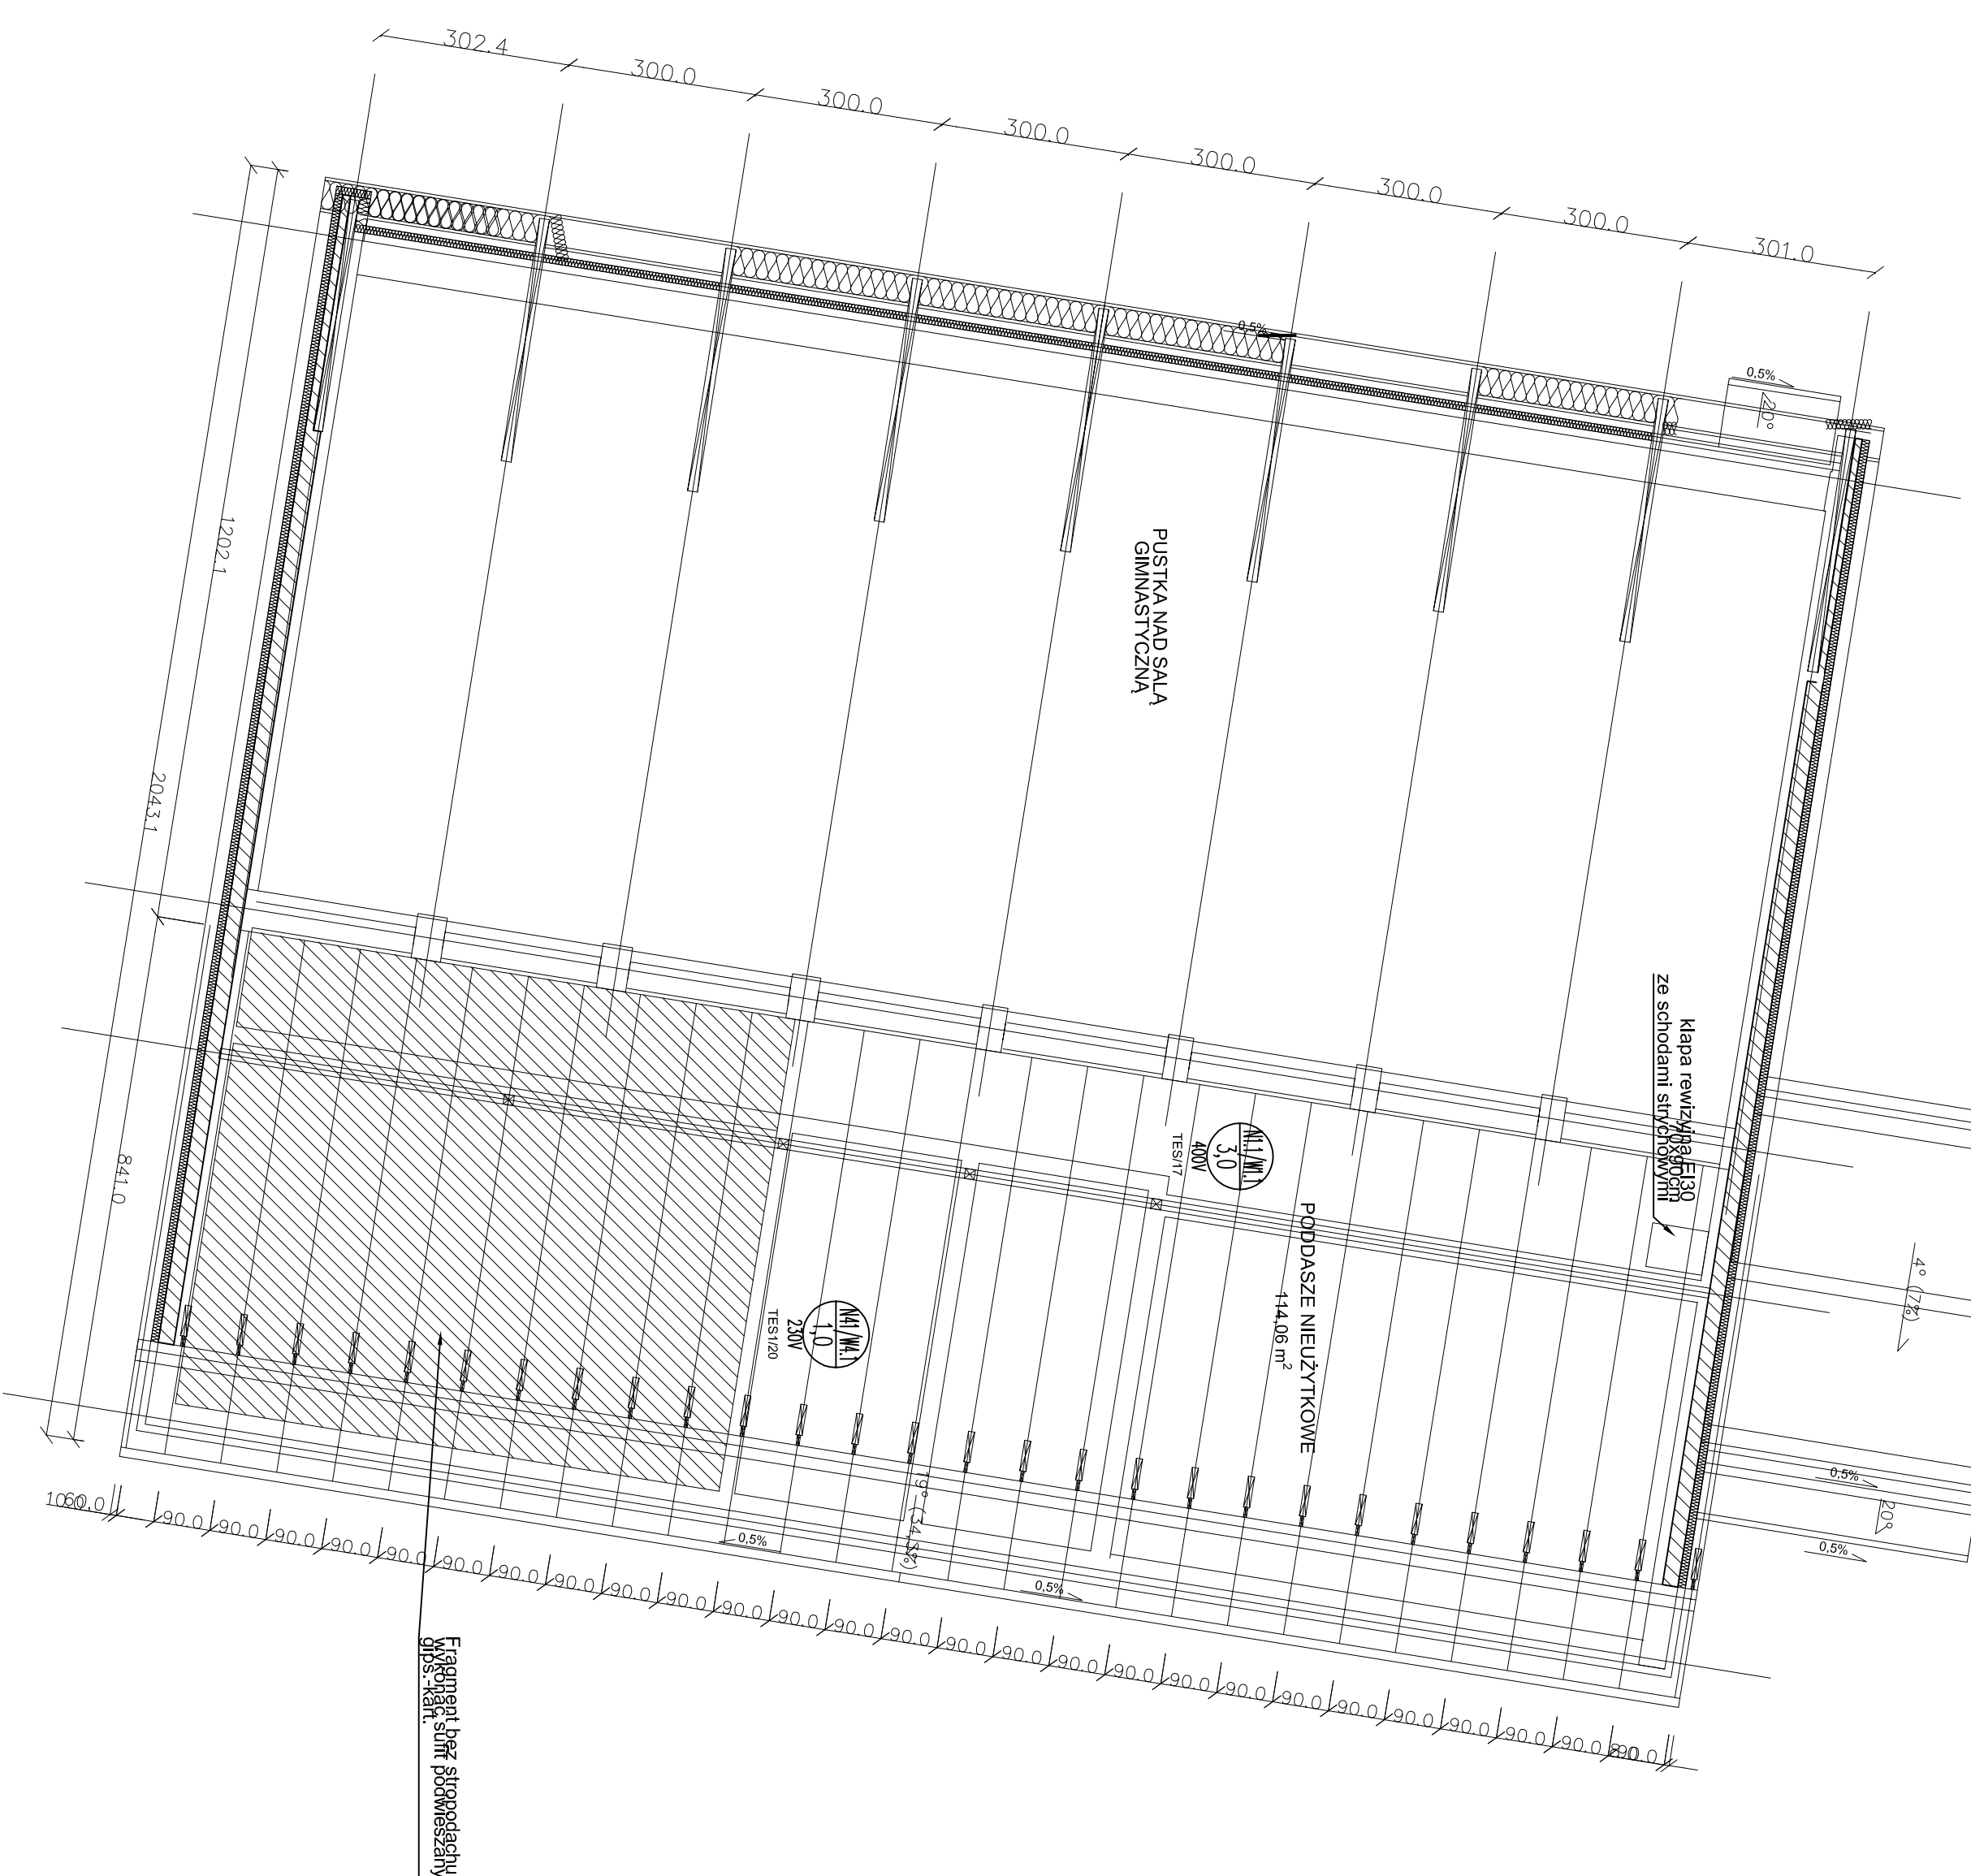


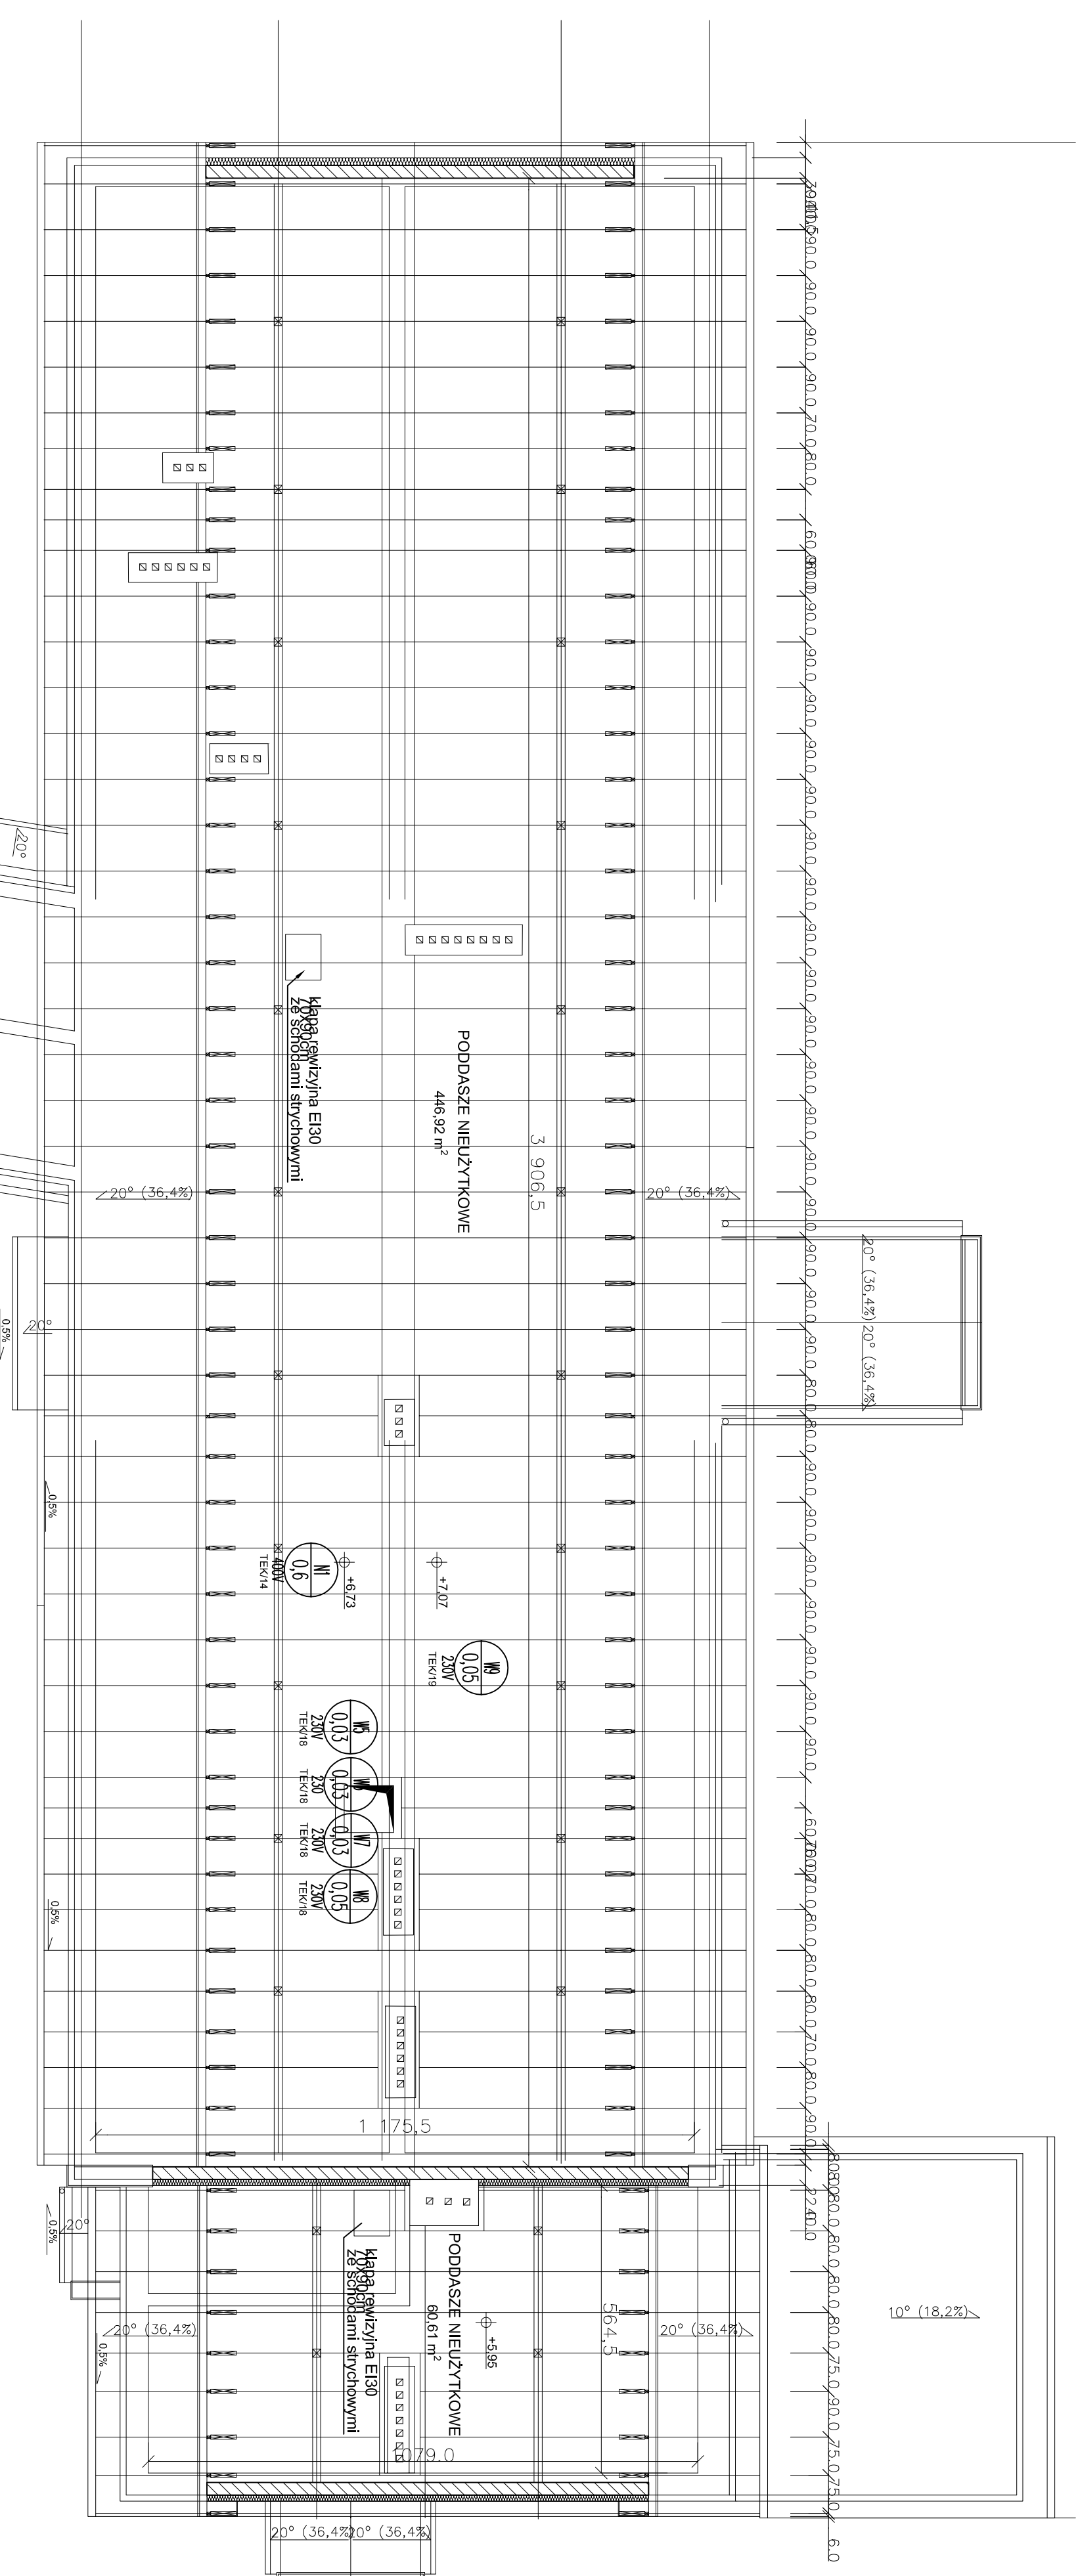

Urządzenia:

- The diagram illustrates a power distribution system with 9 nodes (W1-W9) and their connections to a central bus (N4). The nodes are arranged in a grid-like structure, with W1-W3 on the left, W4-W6 in the middle, and W7-W9 on the right. The central bus (N4) is connected to all nodes. The power ratings for each node are as follows:

 - W1: 0.6 kW, 400V
 - W2: 0.6 kW, 400V
 - W3: 0.6 kW, 400V
 - W4: 1.0 kW, 230V
 - W5: 0.3 kW, 230V
 - W6: 0.3 kW, 230V
 - W7: 0.3 kW, 230V
 - W8: 0.5 kW, 230V
 - W9: 0.5 kW, 230V

The central bus (N4) is connected to all nodes. The power ratings for the central bus are 1.0 kW, 230V.

The diagram shows the following connections:

 - W1, W2, W3 are connected to N4.
 - W4, W5, W6 are connected to N4.
 - W7, W8, W9 are connected to N4.

The power ratings for the central bus (N4) are 1.0 kW, 230V.

[illegible]